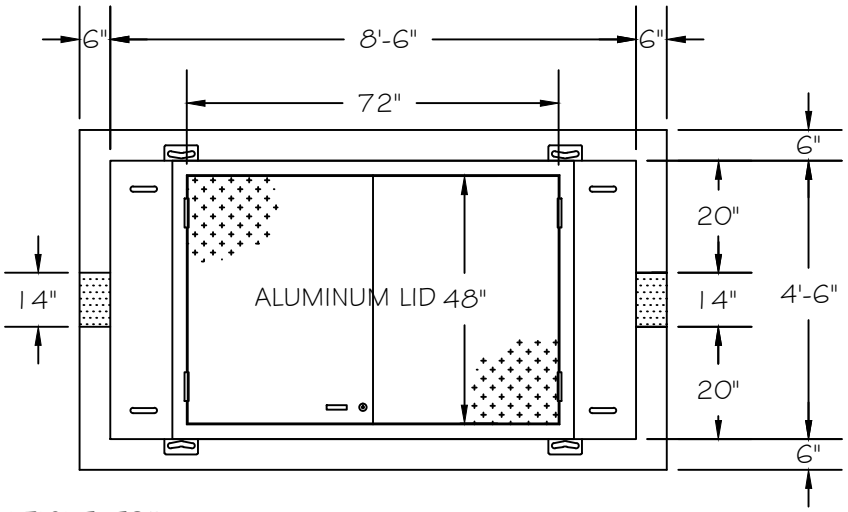

WEIGHT: TOP:
10,600 LBS
BOTTOM:
8,700 LBS

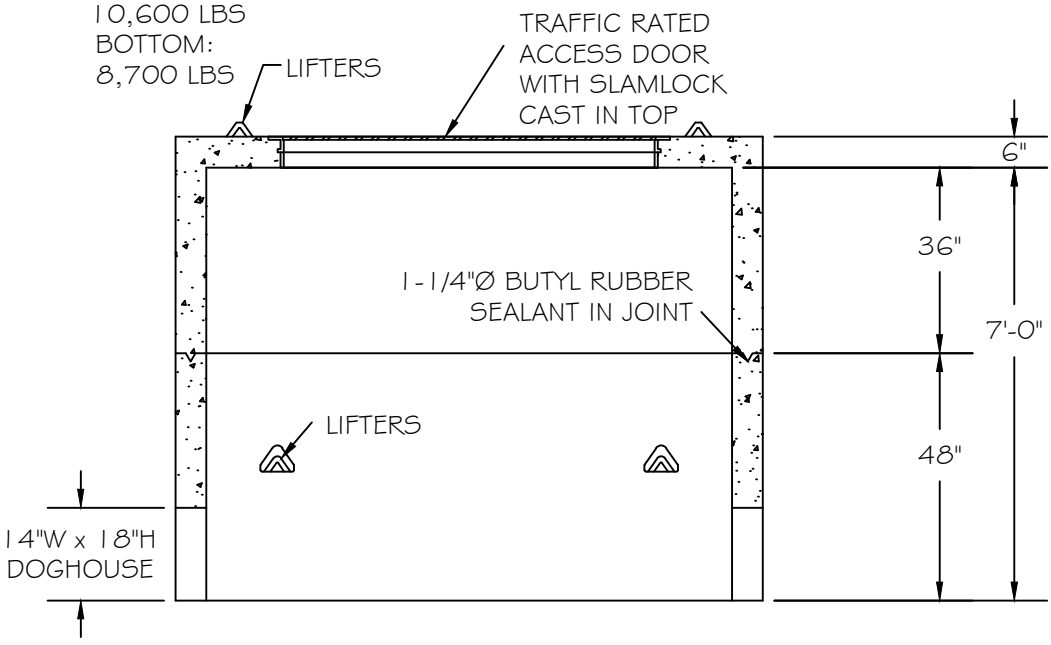

NOTES:
1) REINFORCEMENT: #4 @ 6" OCEW
2) CONCRETE: 4,000 PSI @ 28 DAYS
3) 6" OF #67 STONE SHALL BE PLACED IN BOTTOM OF VAULT
4) METER FLANGE SHALL BE PLACED 49 " BELOW FINISHED GRADE

CITY OF RALEIGH

DEPARTMENT OF PUBLIC UTILITIES

TYPICAL 6" THRU 10" WATER METER VAULT

DWG. NO.	REVISIONS	DATE	REVISIONS	DATE
W-33	A.B.B.	8-26-04		
	D.H.L.	6-18-08		