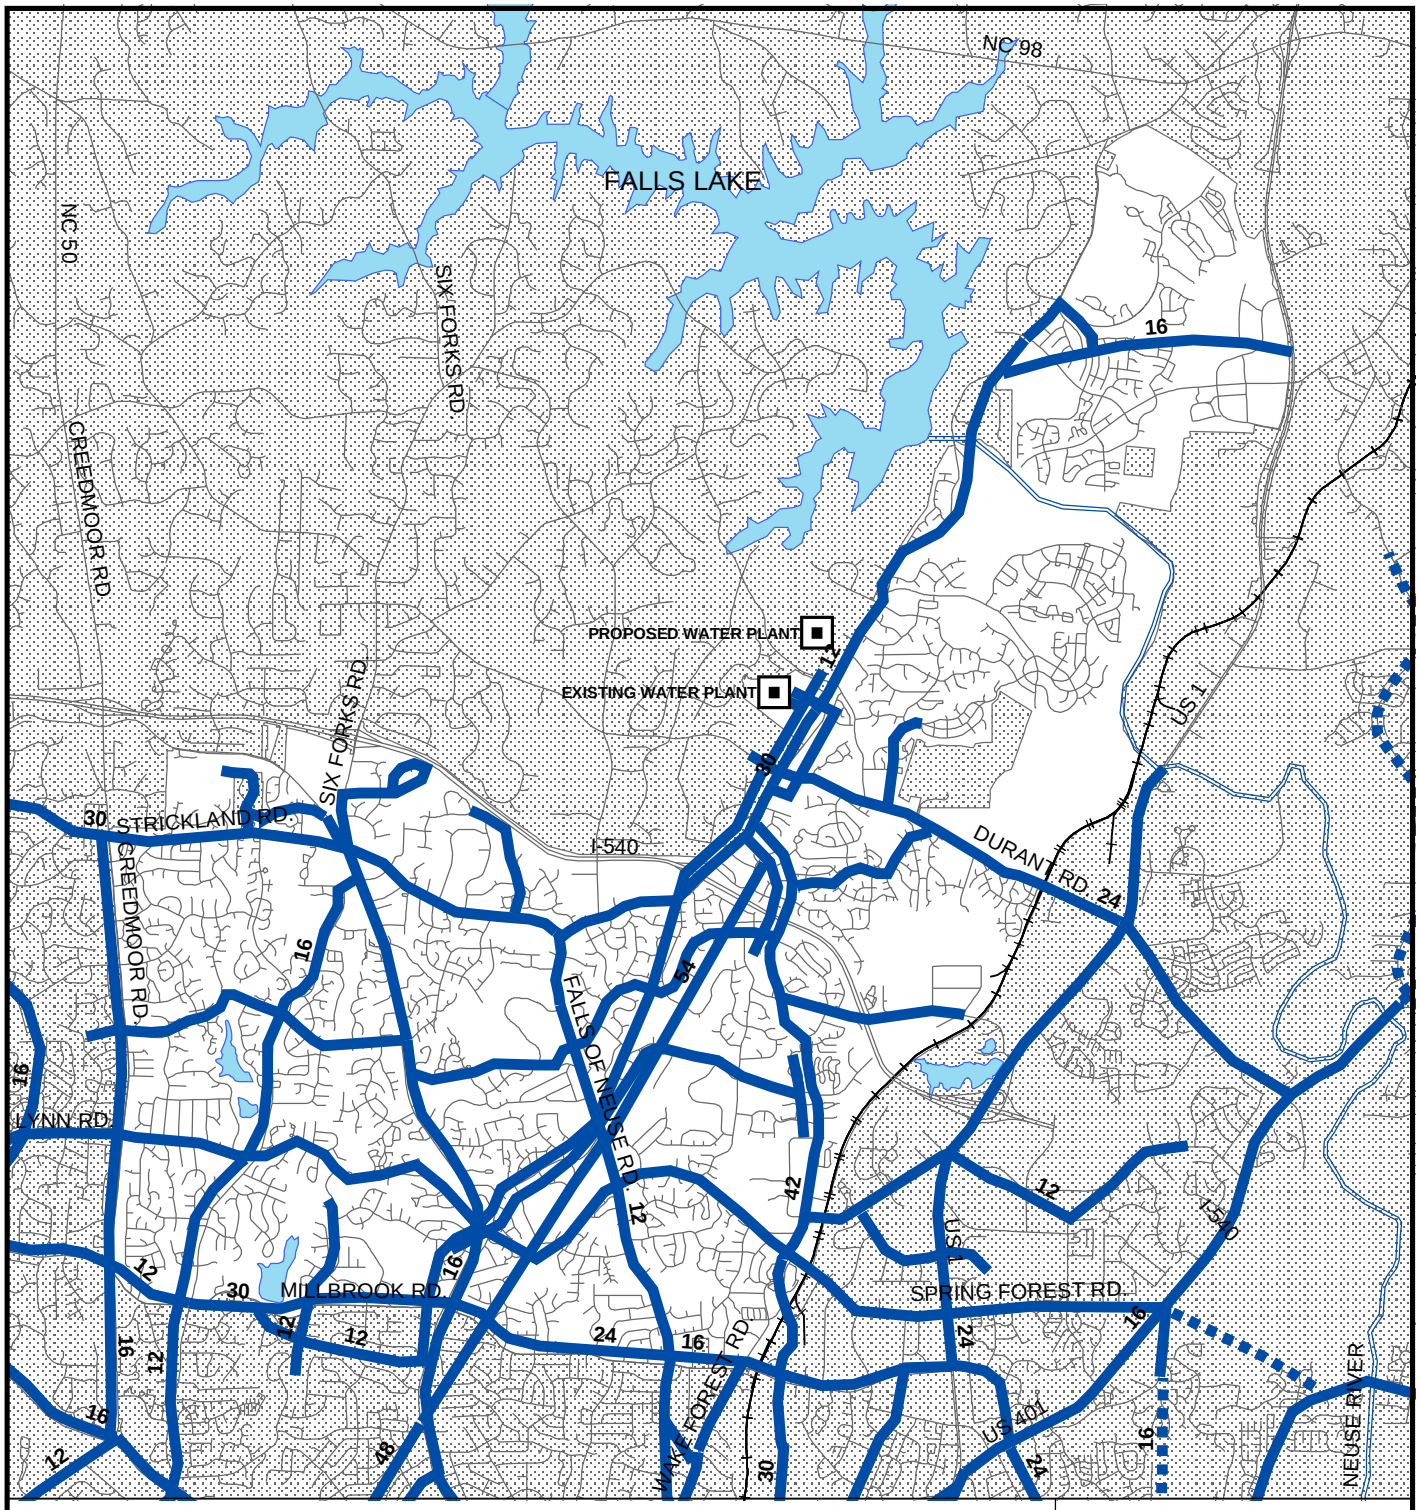

Water System - North District

PROPOSED WATERLINES

EXISTING WATERLINES

WATER TREATMENT PLANT

DISTRICT

0.8 0.4 0 0.8 Miles