



NOTES:

1. FOR 24" PIPE & LARGER USE PIPE DIAMETER PLUS 12" FOR MINIMUM INSIDE DIMENSION.
2. USE 4" X 4" X 8" OR 4" X 8" X 16" SOLID CONCRETE BLOCK. CAST IN PLACE OR PRECAST CONCRETE TO MEET NCDOT STANDARDS ACCEPTABLE.
3. FOR STEP REQUIREMENTS, SEE NOTE #2 ON STANDARD NO SW-10.13.

CONCRETE SLAB TOP

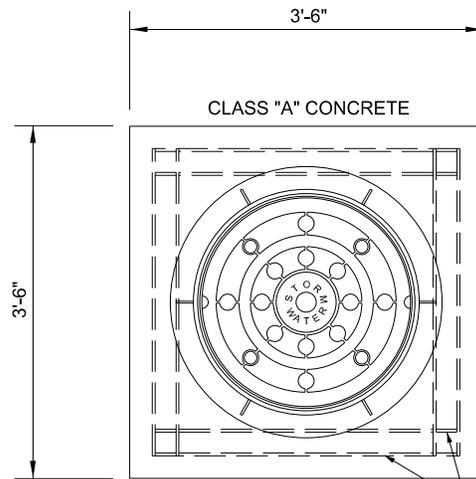

NO.3 REBAR 3" O.C. PLACED 3" FROM EDGE, ALL SIDES.

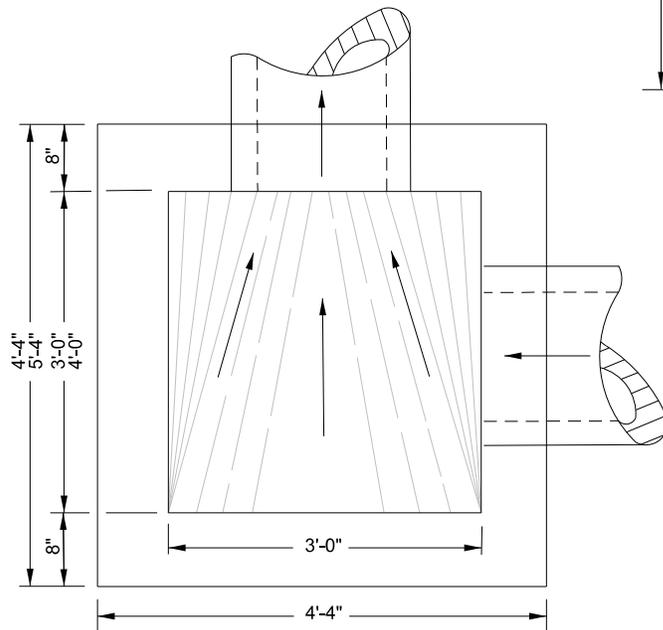

CITY OF RALEIGH PUBLIC WORKS DEPARTMENT		
REVISIONS	DATE: 9/11/13	NOT TO SCALE
STANDARD JUNCTION BOX		
SW-10.04		